



USER MANUAL

Longo Motor Drive LMD-2



Written by SMARTEH d.o.o. Copyright © 2020, SMARTEH d.o.o.

User Manual

Document Version: 7 September, 2023



i





STANDARDS AND PROVISIONS: Standards, recommendations, regulations and provisions of the country in which the devices will operate, must be considered while planning and setting up electrical devices. Work on 230 VAC network is allowed for authorized personnel only.

DANGER WARNINGS: Devices or modules must be protected from moisture, dirt and damage during transport, storing and operation.

WARRANTY CONDITIONS: For all modules LONGO Motor Drive - if no modifications are performed upon and are correctly connected by authorized personnel - in consideration of maximum allowed connecting power, we offer warranty for 24 months from date of sale to end buyer. In case of claims within warranty time, which are based on material malfunctions the producer offers free replacement. The method of return of malfunctioned module, together with description, can be arranged with our authorized representative. Warranty does not include damage due to transport or because of unconsidered corresponding regulations of the country, where the module is installed.

This device must be connected properly by the provided connection scheme in this manual. Misconnections may result in device damage, fire or personal injury.

Hazardous voltage in the device can cause electric shock and may result in personal injury or death.

NEVER SERVICE THIS PRODUCT YOURSELF!

This device must not be installed in the systems critical for life (e.g. medical devices, aircrafts, etc.).

If the device is used in a manner not specified by the manufacturer, the degree of protection provided by the equipment may be impaired. Waste electrical and electronic equipment (WEEE) must be collected separately!

LONGO Motor Drive complies to the following standards:

- EMC:EN 61000-6-2 (EN 50082), EN 61000-6-4 (EN 50081)
- LVD: IEC 61010
- Vibrations and climatic-mechanical: EN 60068-2-6, EN 60068-2-27, EN 60068-2-29

Smarteh d.o.o. operates a policy of continuous development. Therefore we reserve the right to make changes and improvements to any of the products described in this manual without any prior notice

MANUFACTURER: SMARTEH d.o.o. Poljubinj 114 5220 Tolmin Slovenia









Index

Longo Motor Drive LMD-2

1 DESCRIPTION	
2 FEATURES	2
3 INSTALLATION	3
3.1 Connection scheme	3
3.2 Connection scheme LMD-2 with Filter	
3.3 Mounting instructions	
3.4 LMD-2 Module labeling	
3.5 LMD-2 with Filter Module labeling	
4 TECHNICAL SPECIFICATIONS	10
5 CHANGES	11
6 NOTES	12







1 DESCRIPTION

LMD-2 is step less motor driver which controls the voltage for the motor in a way that motor does not cause any additional noise for the sake of the driving mode. Main usage of this unit is in air preparation apparatus, where variable fan speed is needed and additional noise would be disturbing.

Output voltage is PWM modulated with frequency higher than 20 kHz. Output is related to control input signal voltage, current, external potentiometer resistance or internal potentiometer position.

Unit can drive also other type of electric equipment which may be controlled with varying the voltage size.

When connection cable between LMD and motor exceed 2 meters external filter (PN.: 206EMC20002001) must be used. If not, LMD motor drive can be damaged and EMC pollution will be to high. In this case shielded cable Figure 3 is not mandatory to be used for LMD and motor connection.

Please contact producer for detailed information regarding external filter usage in specific application.







2 FEATURES

Figure 1: LMD2 module

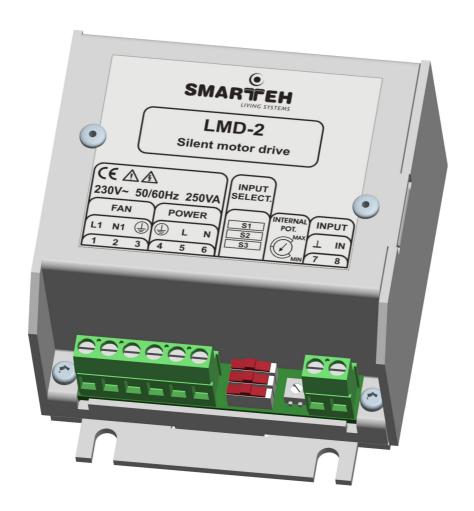


Table 1: Technical data

variable voltage output

load up to 250 VA1

various input control signals






3 INSTALLATION

3.1 Connection scheme

Figure 2: Connection scheme

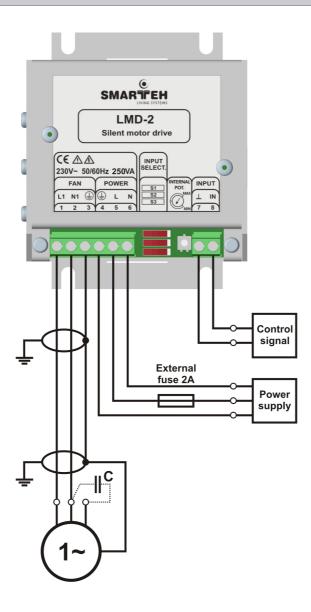

Note: For wiring motor with capacitor shifted winding always connect FAN.1 (L1) from LMD-2 to motor winding with no capacitor connected, as shown on Figure 2

Shielded cable is mandatory.


When connection cable between LMD and motor exceed 2 meters external filter (PN.: 206EMC20002001) must be used. If not, LMD motor drive can be damaged and EMC pollution will be to high.





3.2 Connection scheme LMD-2 with Filter

Figure 3: Connection scheme

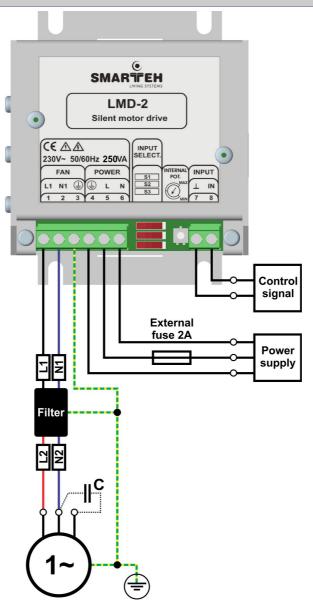

Note: For wiring motor with capacitor shifted winding always connect FAN.1 (L1) from LMD-2 to motor winding with no capacitor connected, as shown on Figure 3.

When connection cable between LMD and motor exceed 2 meters external filter (PN.: 206EMC20002001) must be used. If not, LMD motor drive can be damaged and EMC pollution will be to high.

Please contact producer for detailed information regarding external filter usage in specific application.







Table 2: FAN		
FAN.1	230 VAC	Phase line
FAN.2	230 VAC	Neutral line
FAN.3	PE	Protective earth

Table 3: POWE	:R	
POWER.4	PE	Protective earth
POWER.5	230 VAC	Power supply - Phase line
POWER.6	230 VAC	Power supply - Neutral line

Control signal is different for various versions of JUMPER settings. When internal potentiometer is selected, use installed potentiometer for fan speed setting. See Table 4 below.

Table 4	: INPUT				
	\$1 • S2 S3	\$1 \$2 \$3	\$1 \$2 \$3	\$1 \$2 \$3	Input selection switches
INPUT.7	1	Т	Т	Т	Control signal reference
INPUT.8	0 10 V Rin = 20 kΩ	0 20 mA Rin = 250 Ω	External 10kΩ potentiometer	* Internal potentiometer	Control signal input

^{*} Additional switch can be added between control signal reference (INPUT.7) and control signal input (INPUT.8) for switching LMD-2 silent motor drive on / off:



when switch is off, contact break, LMD-2 is on and output voltage is related to internal potentiometer position

⁻ when switch is on, contact made, LMD-2 output is off





3.3 Mounting instructions

Figure 4: Housing dimensions

82
62
50
10
93
10

Dimensions in millimeters.

EXTERNAL SWITCH OR CIRCUIT-BREAKER AND EXTERNAL OVERCURRENT PROTECTION: The unit is allowed to be connected to installation with over current protection that has nominal value of 2 A up to 10 A.

RECOMMENDATION ON SWITCH OR CIRCUIT-BREAKER PROTECTION: There should be two poles main switch in the installation in order to switch off the unit. The switch should meet the requirements of standard IEC60947 and have a nominal value at least 10 A. The switch or circuit-breaker should be within easy reach of the operator. It should be marked as the disconnecting device for the equipment.



All connections, module attachments and assembling must be done while module is not connected to the main power supply.







Mounting instructions:

- 1. Switch OFF main power supply.
- 2. Mount LMD-2 to the provided place.
- 3. Connect drive output wires according to the connection scheme in Figure 2 or Figure 3.
- 4. ATTENTION: Check again that the connected load power does not exceed 250 VA!²
- 5. Connect power supply wires according to the connection scheme in Figure 2.
- 6. Switch ON main power supply.

Dismount in reverse order.

For good heat transfer from the unit it should be mounted on metal surface or adequate air cooling should be provided.

The unit must be connected to protective earthing of the mains supply installation.

Unit wiring must be accomplished with wires with temperature range 105°C.





3.4 LMD-2 Module labeling

Below is example prototype only.

Figure 5: Labels on housing

Label 1 example:

LMD-2.U01

P/N:208LMD10001002

D/C: 34/10

Label 2 example:

S/N: LMD-S9-1000000190

Label 1 description:

1. LMD-2 is the full product name.

U01 - version

- 2. P/N:208LMD10001002 is the part number.
 - 208 general code for product family,
 - LMD short product name,
 - 10001 sequence code,
 - 10 year of code opening
 - 001 derivation code
 - 002 version code (reserved for future HW and/or SW firmware upgrades).
- 3. **D/C:34/10** is the date code.
 - 34 week and
 - 10 year of production.

Label 2 description:

- 1. **S/N:LMD-S9-0500000190** is the serial number.
 - LMD short product name,
 - **S9** user code (test procedure, e.g. Smarteh person xxx),
 - 1000000190 year and current stack code,
 - 10 year (last two cyphers)
 - 00000190 current stack number; previous module would have the stack number 00000189 and the next one 00000191.





3.5 LMD-2 with Filter Module labeling

Below is example prototype only.

Figure 6: Labels on housing

Label 1 example:

Label 2 example:

LMD-2.U01

P/N:208LMD13001003

D/C: 34/10

S/N: LMD-S9-1000000190

Label 1 description:

3. LMD-2 is the full product name.

U01 - version

- 4. P/N:208LMD13001003 is the part number.
 - 208 general code for product family,
 - LMD short product name,
 - 13001 sequence code,
 - 13 year of code opening
 - 001 derivation code
 - 003 version code (reserved for future HW and/or SW firmware upgrades).
- 3. **D/C:34/10** is the date code.
 - 34 week and
 - 10 year of production.

Label 2 description:

- 1. **S/N:LMD-S9-0500000190** is the serial number.
 - LMD short product name,
 - **S9** user code (test procedure, e.g. Smarteh person xxx),
 - 100000190 year and current stack code,
 - 10 year (last two cyphers)
 - 00000190 current stack number; previous module would have the stack number 00000189 and the next one 00000191.





4 TECHNICAL SPECIFICATIONS

Table 6: Technical specifications	S
Power supply	230 V AC, -15% +10%, 50/60 Hz
Maximum load	250 VA
Maximum load with filter	180 VA
Rated load voltage	230 VAC, 50/60 Hz
Rated load current	1.1 A
Output switching frequency	> 20 kHz
Connection type	screw type connectors for stranded wire 0.75 to 2.5 mm²
Dimensions (L x W x H)	82 x 93 x 47 mm
Weight	350 g
Ambient temperature	0 to 40 °C
Ambient humidity	max. 95 %, no condensation
Transport and storage temperature	-20 to 60 °C
Pollution degree	2
Over voltage category	II







5 CHANGES

The following table describes all the changes to the document.

Date	٧.	Description
20.09.2023	7	Appendix A removed, table 4 updated.
09.07.2020	6	Table 6 update.
01.04.2020	5	Appendix A added.
17.03.2020	4	External filter part number changed.
01.12.2014	3	Data update.
01.12.2012	2	New PN added (LMD-2 with LC filter).
02.09.2010	1	The initial version, issued as LMD-2 UserManual.







6 NOTES

